



NOTES:

1. Pipe post shall be set to provide 1'-6" clearance from face of curb, unless otherwise specified.
2. Where barricade posts are installed in existing concrete sidewalk, the post may be anchored to the sidewalk as shown in the 'Post Anchorage Detail.'
3. Steel sleeves to be constructed with an inside diameter $\frac{1}{10}$ " larger than outside diameter of post. Wall thickness of sleeve to be same as post, or larger.
4. Breakaway score to be located 2"-4" above top of steel sleeve.

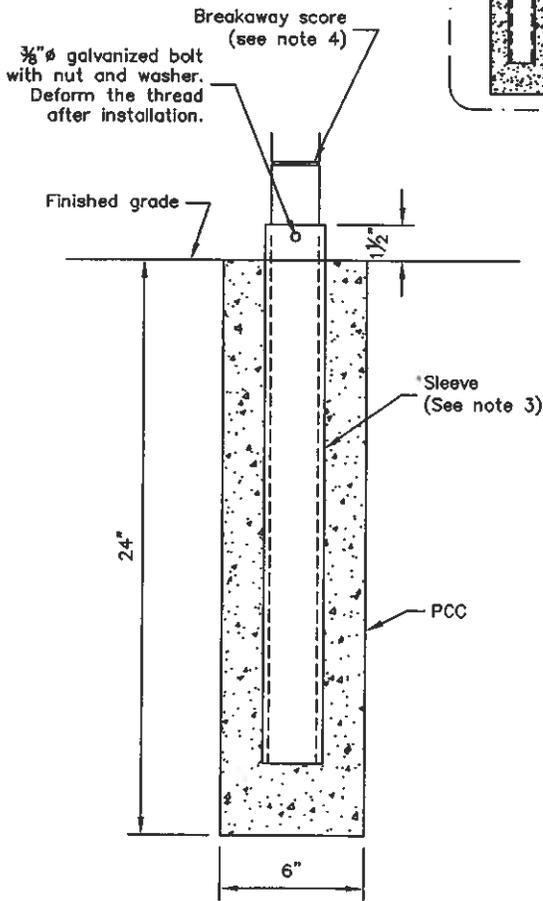

SLEEVE POST DETAIL
Use unless otherwise noted

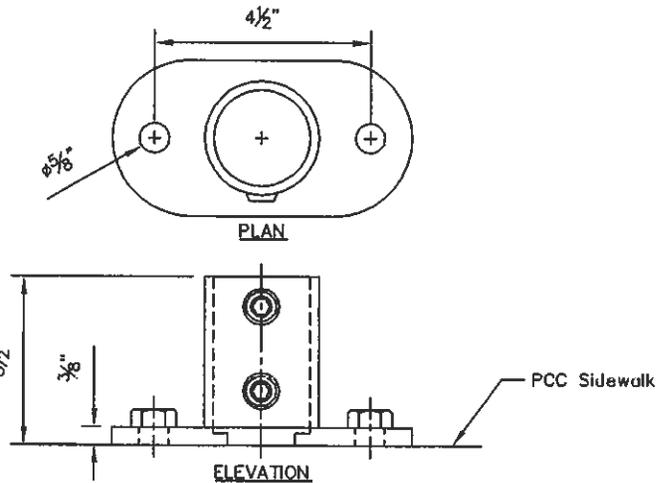

POST ANCHORAGE DETAIL
Contact City for sample

Not to Scale



Nex Pasana!
City Engineer
04-24-09
Date

NO	BY	DATE	REVISION

SHEET
1 of 1

PEDESTRIAN
BARRICADE

S-22